

DRI-EAZ

F391 Owner's Manual

Dri-Eaz[®] CMC100 Dehumidifier

DRI-EAZ PRODUCTS, INC.

15180 Josh Wilson Road, Burlington, WA 98233

Phone: 800-932-3030 Fax: (360) 757-7950 www.dri-eaz.com

The CMC100 automatically controls humidity in confined areas in many types of spaces, including facilities, marine environments and in residential areas such as crawlspaces, attics and basements.

READ AND SAVE THESE INSTRUCTIONS



Read and understand manual before operating.

ELECTRIC SHOCK HAZARD

WARNING! Unit must be grounded.

- Keep motor and wiring dry. Keep out of standing water and do not install in area likely to be subject to water intrusion. Do not expose to rain, water or snow.
- Insert three-prong plug on power cord into a matching electrically grounded outlet. Do not use adapter. Never cut off third prong. Do not use an extension cord.
- To reduce the risk of fire or electric shock, do not use this unit with any solid-state speed control device.

FIRE HAZARD

- Keep away from open flames and heat sources.
- Do not use or store where vapors from gasoline, solvents, thinners or other flammable materials may be present.

SAFETY INSTRUCTIONS

WARNING! Unplug unit before cleaning or servicing.

- Turn off unit and unplug before lifting or moving.
- Handle the unit carefully. Always operate the unit on a stable, level surface. Do not drop, throw, or place where it could fall. Rough treatment can damage the unit, and may create a hazardous condition or void the warranty.
- Inspect the power cord before use. If cord is damaged, do not use. Always grasp the plug (not the cord) to unplug.
- The unit must be operated on a 115V/60 Hz circuit protected by a Ground Fault Interrupter (GFI) device.
- This appliance is not intended for use by persons (including children) with reduced physical, sensory or mental capabilities, or lack of experience and knowledge, unless they have supervision or have been given instruction concerning use of the appliance by a person responsible for their safety.

- Do not attempt to repair the unit. For Authorized Service Centers, call Dri-Eaz Service at 800-932-3030.

INTRODUCTION

The CMC100 reduces humidity in enclosed structural environments by removing water vapor from the air. With proper use, the CMC100 can help to dry out damp structural materials, insulation, and contents, and maintain a healthy level of humidity. Using the CMC100 may also prevent secondary damage caused by high humidity.

How the CMC100 works

The CMC100 refrigerant dehumidifier uses a fan to draw moist air in and condenses it into water that collects in a tray and is automatically pumped out through a drain hose. A humidistat automatically shuts the unit off when the desired level of humidity has been achieved. For optimum results, Dri-Eaz recommends a setting of 60% RH.

Features:

- Industrial-quality dehumidifier removes up to 70 pints (33 liters) of water per day.
- Automatic humidistat control means set-and-forget convenience.
- Ductable outlet for flexible application.
- Recessed handles for easy positioning in confined spaces.
- Interchangeable intake and output panels allow for use in a wide variety of settings.
- Quiet operation and low power consumption.
- The CMC100 has been awarded the ENERGY STAR

INSTALLATION

Location

The CMC100 works best in an enclosed area, as this creates a drying chamber. Excessive infiltration of damp air will increase operating time.

How to position the CMC100 dehumidifier

Place your CMC100 dehumidifier in the middle of the space, away from walls, footings, ducts and other materials that may prevent the free flow of air around and through the unit.

Keep unit level

The unit must be level to operate properly. Four screw-in adjustable foot pads are provided. If the CMC is to be used on an uneven surface, these feet must be installed into the bottom

of the CMC before placing the unit into service. To level the unit with the feet, place a carpenter's level on the top of the unit and adjust the footpads to raise or lower each corner of the unit until it is level.

Set out the drain hose

During operation, water condenses out of the air and collects in a drain pan inside the unit. The CMC100 automatically pumps out this water through the drain hose outlet (see Figure 2). Dri-Eaz recommends directing the hose into a drain or well away from area to be kept dry. Note: Do not place the end of the drain hose higher than 3 feet (1 meter) above the top of the CMC, or leaking may occur.

Pump operation

Depending on operating conditions, the unit may produce condensate water intermittently, in a steady stream, or not at all for short periods of time. These functions indicate normal dehumidifier and pump-purge operations.

Duct the outlet for optimum performance


The processed air outlet is designed to accept standard 6 inch ducting (not included). For best results, use ducting and fasten it securely to the duct ring (see Figure 3). Place the open end of the duct some distance away from the unit. Ducting the processed (outlet) air away from the unit will help to ensure more complete distribution of dehumidified air throughout the drying area. Install with insulated flex ducting for the quietest operation.

OPTIONAL CONFIGURATIONS

The CMC100 features interchangeable panels that allow the unit to be adapted for use on shelves, small storage areas or in other locations where directing the air straight through the unit is not possible. The damp air intake can be set up to draw in air from the end of the unit or from the side of the unit. Similarly, the dry air output can be set up to exhaust processed air from the end of the unit or from the side of the unit. See Figure 1, below.

To change the configuration, first unplug the CMC, then remove the four screws that hold each panel in place (see Figures 2 and 3). Lift the panels out of the CMC frame. Replace the panels in the desired position and carefully tighten the screws. NOTE: When placing both intake and output panels on the side of the unit (option D, below), Dri-Eaz recommends attaching ducting to the output ring and place the open end of the ducting some distance away from the CMC. This will help distribute the processed air more completely.

**FIGURE 1
AIRFLOW OPTIONS (TOP VIEW)**

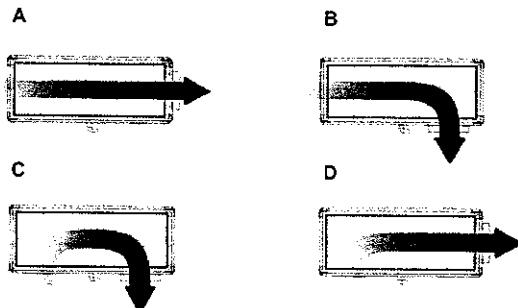

PARTS IDENTIFICATION (SHOWN BELOW)

FIGURE 2


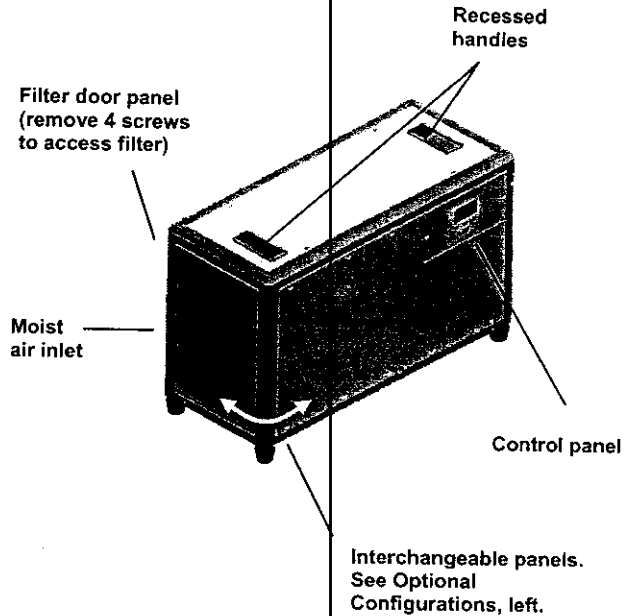



FIGURE 3

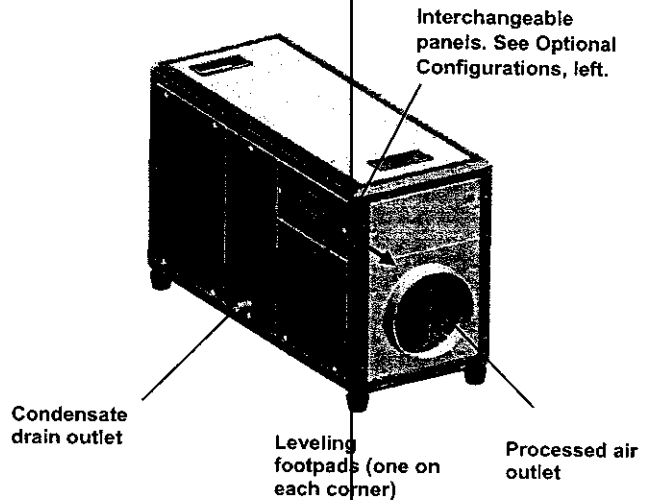

OPERATION

1. Plug in the power cord into a standard 115V grounded outlet. The unit must be operated on a 115V/60 Hz circuit protected by a Ground Fault Interrupter (GFI) device.
2. Attach one end of the drain hose to the condensate drain outlet and directing the other end into a drain or away from area to be kept dry. Note: To prevent CMC100 drain pan overflow, ensure that there are no kinks or sharp bends in the drain hose and do not place the outlet of the hose higher than 3 ft. (1 m) above the top of the CMC100.
3. The CMC100 is controlled by an electronic touchpad humidistat. The unit will automatically start when the humidity of the surrounding air exceeds the humidity level selected.
4. Set humidity set point with Control Panel (see next page).

CONTROL PANEL

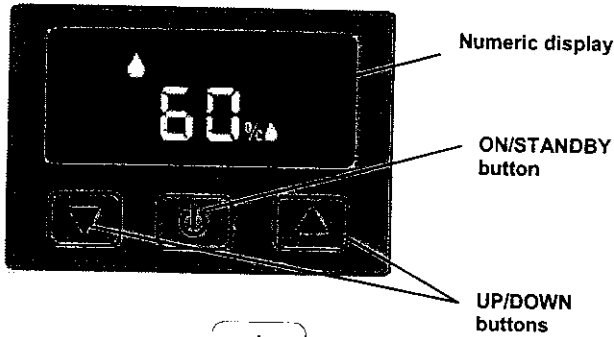

ON/STANDBY button

The ON/STANDBY button toggles the unit between the ON and STANDBY modes. The display indicates the current mode.

1. In the **ON** mode, the display shows the current measured humidity as a percentage of relative humidity.



ON mode display shows current humidity

CHANGING THE HUMIDITY SETTING

To adjust the humidity set point, first set the unit in the ON mode (see above). Now use the UP and DOWN buttons to adjust the humidity set point.



UP button



DOWN button

The value of the humidity set point increases or decreases in 5 percent increments. The display will show the set point only when you press the UP or DOWN buttons. After you have finished adjusting the set point, the display will resume indicating the measured humidity and the CMC will automatically maintain humidity at the selected set point.

2. In the **STANDBY** mode, the display shows a double dash. Unit does not operate in this mode. Press the ON/STANDBY button to return to ON mode.



STANDBY mode

Note: The UP and DOWN buttons do not function in the Stand-by Mode. Press the ON/STANDBY button to resume operation.

ADDITIONAL MODES

The CMC100 also has a DEFROST mode and a LOW TEMPERATURE PROTECTION mode. The unit automatically initiates these modes as conditions warrant. No user intervention is required.

1. As needed, the CMC will automatically enter the **DEFROST mode**. The fan will continue to operate until ready for the next operating cycle. The unit will automatically return to ON mode when the defrost cycle is complete.



DEFROST Mode

2. When the ambient temperature falls below 32°F (0°C), the unit enters **LOW TEMPERATURE PROTECTION mode** and stops operating. The unit will automatically restart when the surrounding temperature rises above freezing.



LOW TEMPERATURE PROTECTION Mode

Automatic water pump out

The unit automatically pumps out condensate through the condensate drain hose. No user intervention is required.

Note: Check for proper operation before leaving the unit unattended. Do not move the CMC100 while it is operating.

MAINTENANCE

WARNING! Unplug unit before cleaning or servicing.

Note: Protect from freezing. Freezing may damage unit.

Note: Check filter one month after first installation for any initial buildup of dust or debris, and clean as needed.

MONTHLY MAINTENANCE

1. **Inspect Power Cord**
Inspect power cord for cuts, fraying or damage; do not use if damaged.
2. **Inspect drain hoses**
Inspect drain hose for kinks, breaks, or obstructions. Make sure the hose is draining properly.
3. **Inspect Exterior**
Inspect exterior cabinet. Make sure air vents are free of any obstructions. Listen to the unit for abnormal sounds. For Parts and Service, call your local distributor or the Dri-Eaz Service Department at 800-932-3030.
4. **Clean Exterior**
Clean the housing with a damp cloth. Make sure inlet and outlet grills are free of dust and debris.

PERIODIC MAINTENANCE

- **Inspect filter element**
The CMC100 is equipped with a washable filter. Inspect the filter by removing the four filter door screws and sliding it out of the filter door panel (see Figure 1). If the filter shows excessive buildup, vacuum it clean and wash it in mild detergent. Replace the filter in the filter door and close the door securely. **Note:** Do not operate the unit without the filter securely in place. If the filter becomes torn or can no longer be adequately cleaned, the filter may be replaced with similar cut-to-fit material available at most hardware stores.

SPECIFICATIONS

Name	CMC 100 Dehumidifier Model F391
Dimensions (W x H x D)	10 x 14 x 24 in. 25.4 x 35.6 x 61 cm
Weight	55 lbs. 25 kg
Air Movement	250 CFM 7.1 m ³
Water Removal	70 pts/day (1.4 L/hr) @ AHAM (80°F/60% RH)
Power	5.3 amps (115V)
Water Removal Efficiency (Energy Factor)	4.8 pts/kWh 2.2 L/kWh
Condensate Pump	Included – internal
Condensate Pump Lift Capacity	3 ft. 1 m
Operating Temperature Range	33°–100°F 0.5°–38°C
Safety	ETL certified to UL 474

Specifications are subject to change without notice. Some values may be approximate.

PARTS INCLUDED

Four screw-in leveling feet
One 15-foot drain hose
One hose clamp for attaching drain hose

FOR PARTS AND SERVICE CALL YOUR LOCAL DISTRIBUTOR or the Dri-Eaz Service Department at 800-932-3030 or 360-757-7776. www.dri-eaz.com

Go to warranty.CMC100.com to register your purchase.



Products that earn the ENERGY STAR help to reduce greenhouse gas emissions by meeting strict energy efficiency guidelines set by the U.S. Environmental Protection Agency and the U.S. Department of Energy.

ENERGY STAR and the ENERGY STAR mark are registered U.S. marks.